



# Universal PSU (FireCell variant) Installation Guide

## General

The Universal PSU (FireCell variant) is available under the following part number;

Part No	Variant Type
FC-60-1000	Universal PSU (FireCell variant)

EN54-4:1998 Power supply equipment for fire detection and fire alarm systems for buildings

The Universal PSU has been designed to be fitted within the FireCell Radio Cluster Communicator (RCC). Please see FireCell Installation & Programming instructions for information on back box mounting, mains supply cable entry points and programming information. Please Note: The Universal PSU has no serviceable parts, so no attempt should be made to access the inside of the power supply unit.

## Overview of the PSU

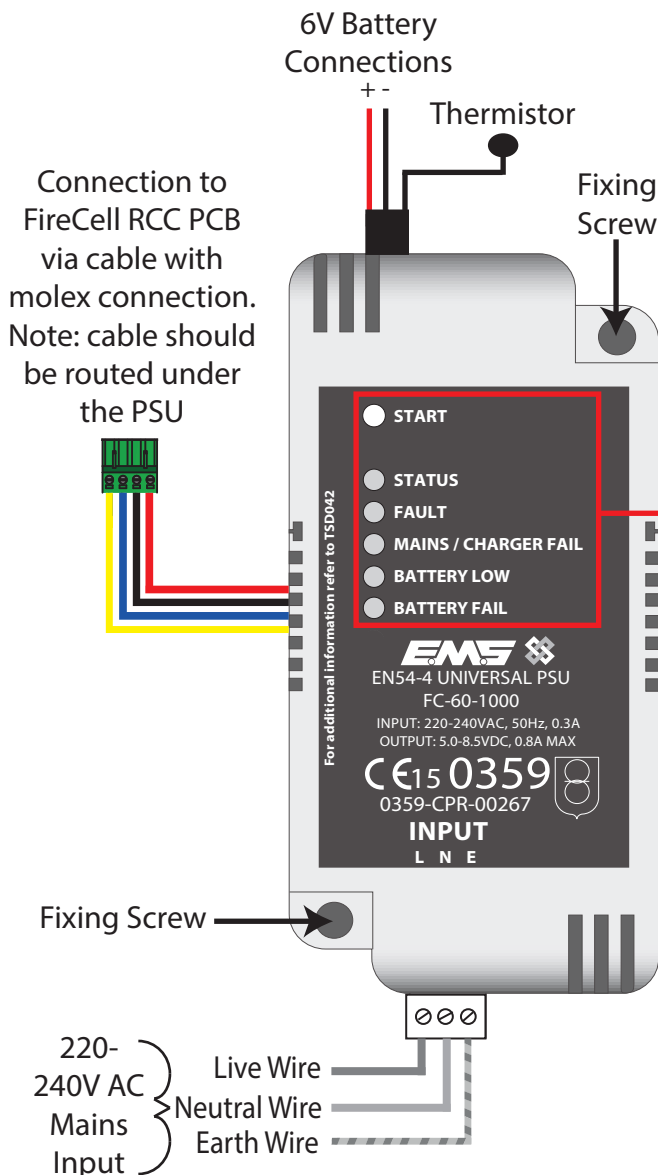


Figure1

**Start Button:** This button can be pressed (for one second) to start up the PSU with the 6V battery connected, whilst Mains is not present. The PSU will now operate in power save mode and the relevant Status LEDs will only illuminate whilst the Start button is pressed. Note; this should only be used in emergency conditions and mains should be connected as soon as possible.

**Status LED:** This LED will be illuminated whilst the PSU is powered. Under mains supply, it will be lit continuously whilst in power save mode (battery only) it will flash.

**Fault LED:** This LED will illuminate when any fault is present in the PSU.

**Mains / Charger Fail LED:** This LED will illuminate whilst the PSU cannot detect a valid mains supply OR when the battery is not charging.

**Battery Low LED:** This LED will illuminate when the battery voltage is below 5.7V.

**Battery Fail LED:** This LED will illuminate when the battery is disconnected.


Note: Allow up to 30 seconds, for the LEDs to reflect a change in condition.

# Installation of the PSU

The following steps should be followed in order to install the PSU into the FireCell RCC.

## Step 1 \* Disconnect Mains Supply


The mains supply must be disconnected before any further work commences.

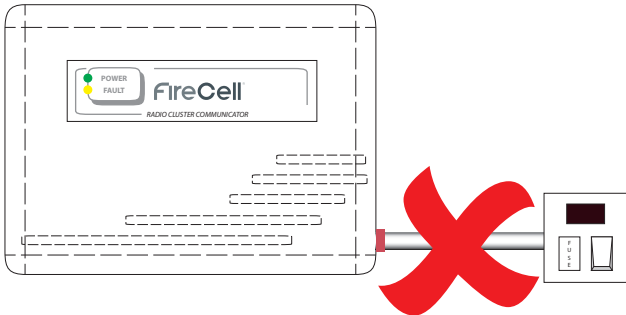

Note: This will result in temporary fault conditions, that will clear once this process is complete.


## Step 2 \* Remove Lid

To remove the RCC's lid, all four corner pieces and screws must be removed.

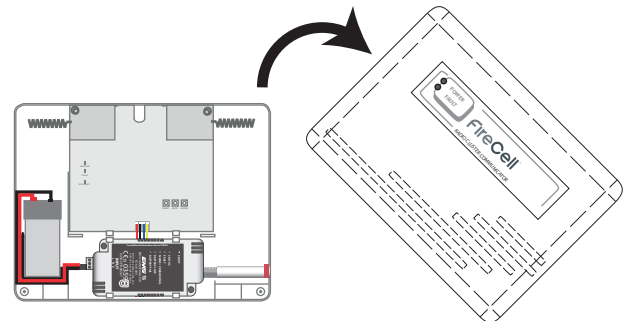

## Step 3 \* Remove Battery


Carefully disconnect and remove the RCC's Battery. The Battery should be kept in a safe place and protected against short circuit.

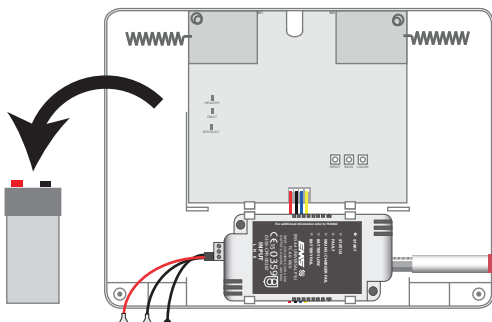

Note: Ensure excessive strain is not placed on the wires or terminals when removing the connections.


## Step 4 Remove Mains Connections

Remove the mains wiring connections.

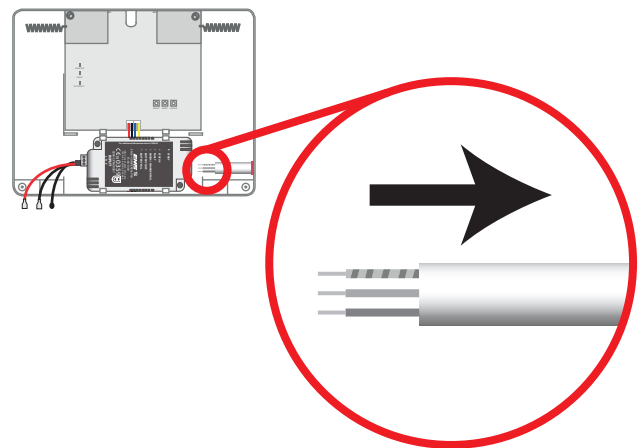


## Step 5 Remove Fixing Screws

Unscrew the PSU's two Fixing Screws.

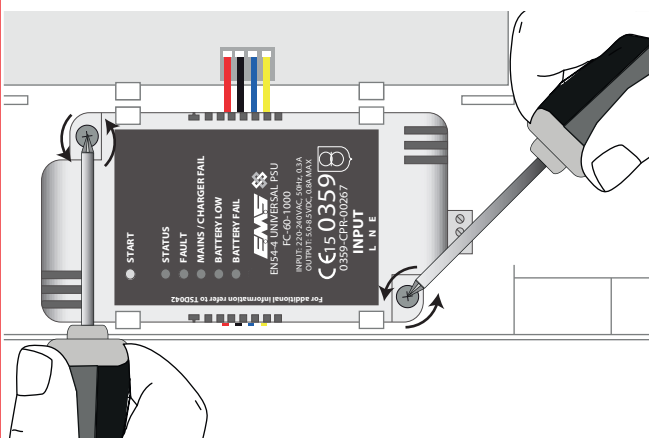


## Step 6 Unplug Ribbon Cable

Unplug the PSU's ribbon cables connector from the RCC's PCB.

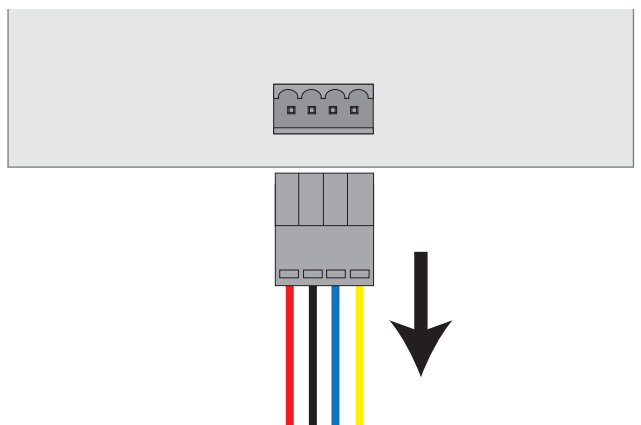


## Step 7 Remove PSU

Remove the PSU from the PSU's Housing.

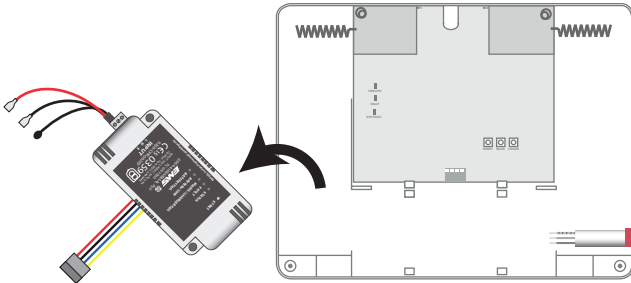

## Step 8 RCC Housing Modification


If upgrading from a previous version of power supply, a small modification to the RCC housing will be required. This includes removing the retaining clips as they are no longer needed. This is detailed below.

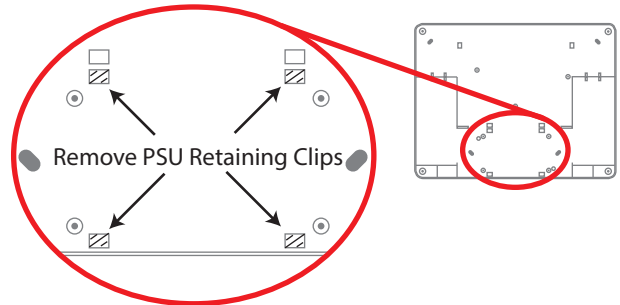

(Remove shaded clips only)

## Step 9 PSU Orientation

The PSU is designed so that it can be fitted in two different orientations, allowing mains entry to the left or right hand side of the RCC Housing. Therefore it is important that the PSU is fitted in the correct orientation.

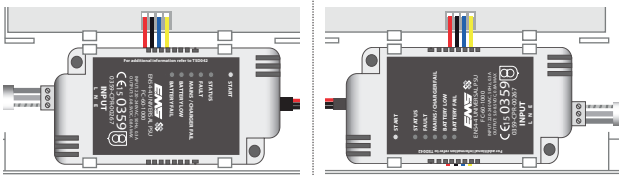


Mains Supply from the left hand side.

Mains Supply from the right hand side.


## Step 10 Insert PSU

The new PSU can now be fitted into the housing. If Step 8 was **NOT** followed, the PSU must now be clipped back in to place. Note; the PSU's Ribbon Cable should run underneath the PSU when mains connections are made to the right hand side. The ribbon cables connector should also be reconnected to the PSU.

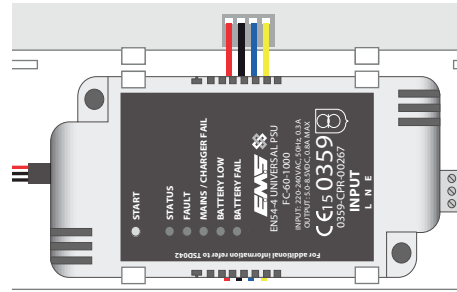


## Step 11 Secure PSU

Secure the PSU into place; fitting the new PSU Retaining Screws, supplied with the replacement PSU.

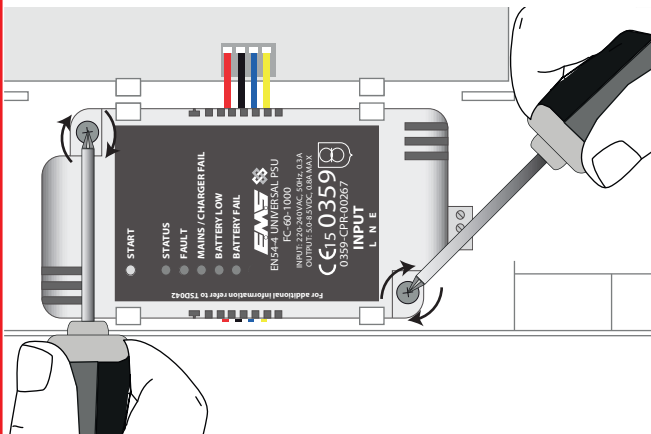


## Step 12 Remake Mains Connections

Remake the mains connections as shown below.

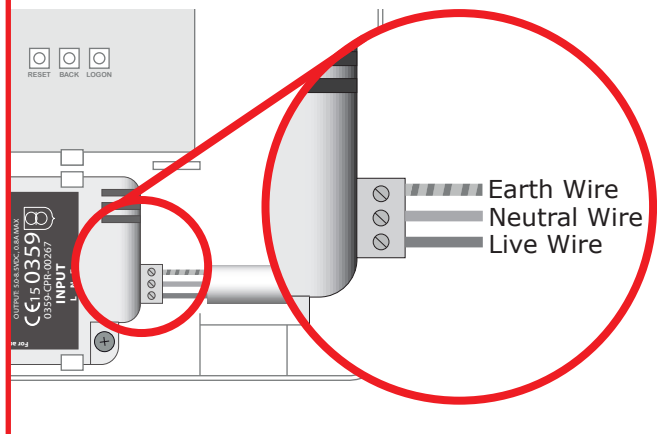


## Step 13 \* Replace Battery

Fit the battery into the battery compartment. House the Thermistor and fit the connectors as shown, ensuring correct polarity is observed.

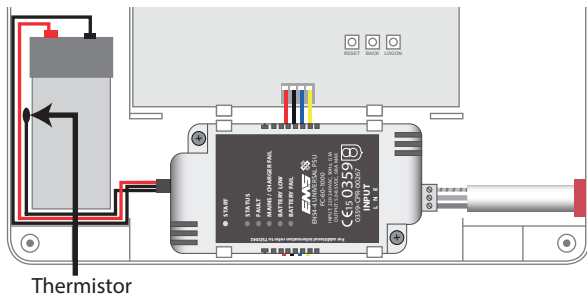


## Step 14 \* Refit Lid

Refit the lid ensuring all four screws and corner pieces are fitted.

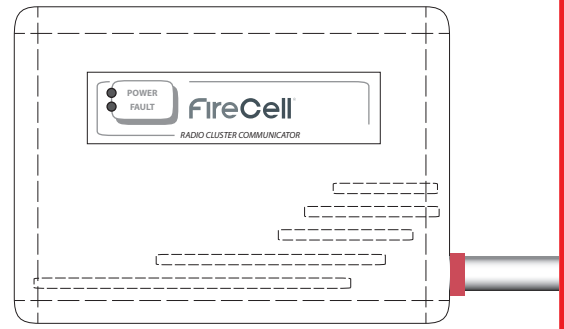


## Step 15 \* Reinstall Mains Supply

Re-apply the mains supply to the RCC.

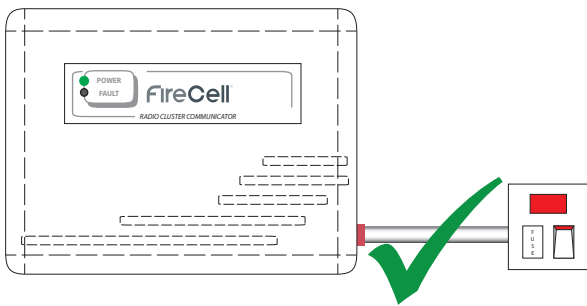

## Step 16 \* Check Radio Hub

Check that after 5 minutes the RCC fault has cleared at the Radio Hub, along with the faults from associated devices. Once clear, the installation process is complete.

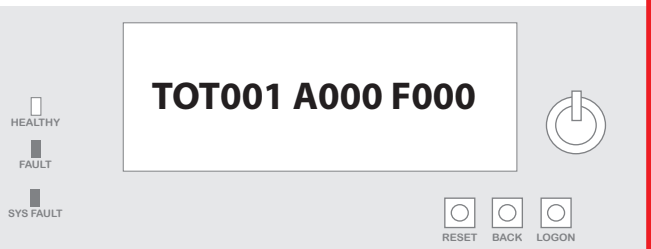

\* When carrying out a routine battery change (within 5 years and as required), steps 1, 2, 3, 13, 14, 15 and 16 can be followed. Ensure that a correct battery type is used. See the Specification section for more information.

### Specification

<b>Operating Temperature</b>	-10°C to 55°C
<b>Power Requirements</b>	Mains Powered 220-240Vac
<b>Min/Max Electrical Ratings</b>	Input: 220-240Vac, 50Hz, 0.3A Output Current: Imin 0.0 Amps, Imaxa 0.8Amps, Imaxb 0.8Amps
<b>Input / Output Fuse Ratings</b>	Input: T3.15A (Non replaceable) Output: 300mA and 750mA Max (Resettable)
<b>Battery Backup</b>	1 x 6V 4Ah Yuasa NP4-6
<b>Battery Standby Time</b>	72 hours
<b>Maximum Battery Internal Resistance</b>	0.7 Ohms
<b>Maximum Current Drawn from the Battery by the PSE with Mains Disconnected</b>	5mA (PSU), plus 100mA (RCC PCB)
<b>Dimensions</b>	53mm (W) 110mm (H) 39mm (D)
<b>Weight</b>	150g

### Regulatory information

<b>Manufacturer</b>	EMS Security Group Ltd. Technology House, Sea Street, Herne Bay, Kent, CT6 8JZ, United Kingdom
<b>Certification</b>	CE 15
<b>Certification body</b>	0359
<b>CPR Certificate DOP</b>	0359-CPR-00267
<b>Approved to</b>	EN54-4:1998 Incorporating Amendments Nos. 1 and 2. Fire detection and fire alarm systems. Part 4: Power supply equipment.
<b>Application</b>	Intended for use in fire detection and fire alarm systems in and around buildings. Indoor use only.
<b>European Union Directives</b>	EMS Security Group Ltd hereby declares that this device is in compliance with the essential requirements and other relevant provisions of EN 50130-4:2011.



2012/19/EU (WEEE directive): Products marked with this symbol can not be disposed of as unsorted municipal waste in the European Union. For proper recycling, return this product to your local supplier upon purchase of equivalent new equipment, or dispose of it at designated collection points. For more information see [www.recyclethis.info](http://www.recyclethis.info)  
Dispose of your batteries in an environmentally friendly manner according to your local regulations.