


SmartCell

Quick operation guide

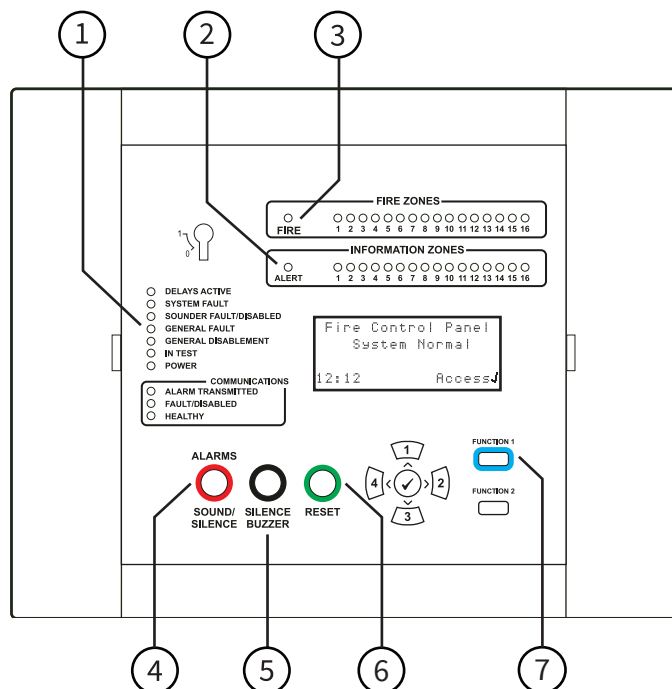

- ① 'GENERAL FAULT' LED
- ② 'ALERT' LED
- ③ 'FIRE' LED
- ④ 'ALARMS SOUND / SILENCE' button
- ⑤ 'SILENCE BUZZER' button
- ⑥ 'RESET' button
- ⑦ 'FUNCTION 1' button

If you hear the buzzer

Determine the cause of the buzzer

WARNING: Depending on your fire alarm system configuration, the buzzer may be your first indication of a fire alarm.


If the buzzer is sounding and the 'FIRE' LED is illuminated, then it's a fire alarm.

If the buzzer is sounding and the 'ALERT' LED is illuminated, then it's an information alert.

If the buzzer is sounding and the 'GENERAL FAULT' LED is illuminated, then it's a fault.

For a fire alarm

1. Determine the location of the fire

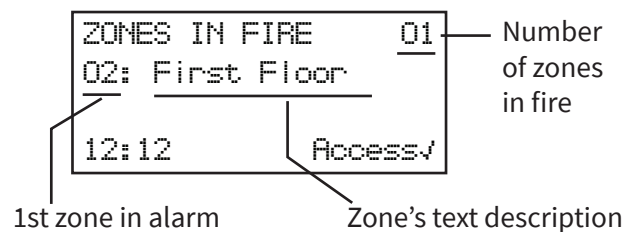

2. Determine the source of the fire alarm

Click the '>' button to view more details.

3. Verify the fire alarm

If necessary, investigate the location of the fire alarm to confirm that the alarm is genuine.

Depending on the configuration of your fire alarm system, you may have up to ten minutes to investigate the alarm before sounders and other alarm notification devices are activated.

4. Activate the sounders

If the fire alarm is verified, do either of the following to activate the sounders and other alarm notification devices immediately:

- Break the nearest manual call point.
— OR —
- Press the 'ALARMS SOUND / SILENCE' button* on the control panel.

* This button only becomes active once a valid user access code has been entered, or the keyswitch has been enabled (turned to the on position).

Caution: Always confirm the cause of the warning signal before silencing the buzzer.


Additional information on the fault is available by pressing '>' button.

5. Leave the building

Once the fire alarm has been confirmed and the fire alarm activated, leave the building and follow your company's evacuation drill.

For an information alert

1. Determine the location of the information alert

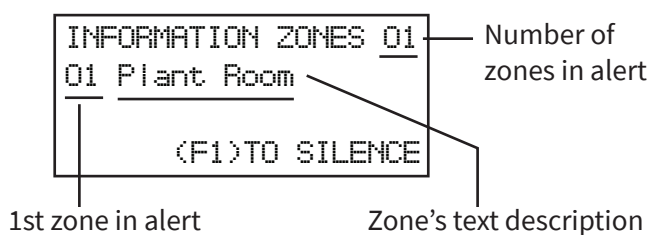

2. Determine the source of the information alert

Click the '>' button to view more details.

3. Verify the alert

If necessary, investigate the location of the information alert to confirm that the alert is genuine.

WARNING: Always follow site guidelines to ensure correct actions are followed.

4. Silence the buzzer

The control panel buzzer can be silenced by pressing the 'SILENCE BUZZER' button.

5. Silence the sounders

The information sounders can be silenced by pressing the 'FUNCTION 1' button.

For a fault

1. Silence the buzzer

To silence the buzzer, press the 'SILENCE BUZZER' button on the control panel.

New alarm or fault events will turn the buzzer back on.

Caution: Always confirm the cause of the warning signal before silencing the buzzer.


Additional information on the fault is available by pressing the '>' button.

2. Contact your maintenance contractor

Contact your maintenance contractor immediately to investigate and repair the fault.

For more information

This document includes basic control panel operation instructions to be followed in the event of a fire alarm, information alert, or fault indication. For detailed operation, refer to the SmartCell user guide (TSD113).



Free to download from
www.mysmartcell.com

Maintenance information

Inspect and test the fire alarm system in accordance with all applicable requirements and regulations.

For service contact:

Name: _____

Address: _____

Telephone: _____